


SEGMENT C-D



NOT TO SCALE

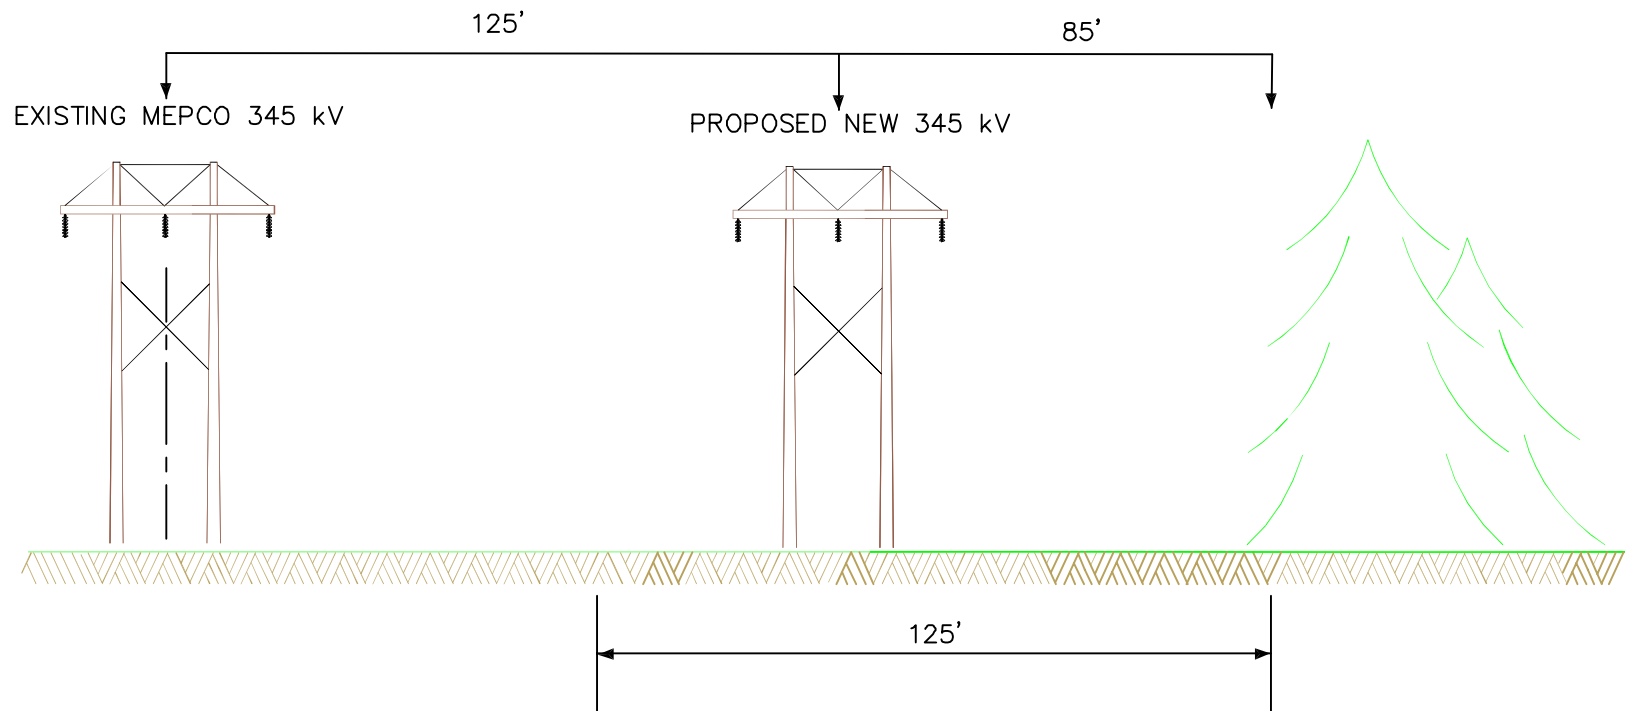

APPENDIX 1-3
TYPICAL ROW CONFIGURATION
ALONG EXISTING MEPCO ROW
BANGOR HYDRO-ELECTRIC COMPANY
NORTHEAST RELIABILITY INTERCONNECT